


ALL BACKFLOW PREVENTION ASSEMBLIES MUST BE APPROVED BY THE UNIVERSITY OF SOUTHERN CALIFORNIA (USC) AND TESTED BY A SAN MATEO COUNTY CERTIFIED TESTER BEFORE APPROVAL OF THE WATER SYSTEM. SEE THE SAN MATEO COUNTY WEB SITE FOR APPROVED LIST OF CERTIFIED TESTER'S AT [HTTP://SMCHealth.org/node/426](http://SMCHealth.org/node/426). FOR ADDITIONAL INFORMATION ON USC APPROVED DEVICES PLEASE CALL THE WATER DIVISION AT (650) 558-7670. PLEASE COMPLETE THE "WATER DEMAND WORKSHEET" FOR DETERMINING THE WATER SERVICE AND METER SIZE. THE WORKSHEET IS AVAILABLE AT THE BUILDING DEPARTMENT OR ON THE CITY OF BURLINGAME WEB SITE AT [HTTP://WWW.BURLINGAME.ORG/INDEX.ASPX?PAGE=125](http://www.burlingame.org/index.aspx?page=125).

ADDRESS: \_\_\_\_\_

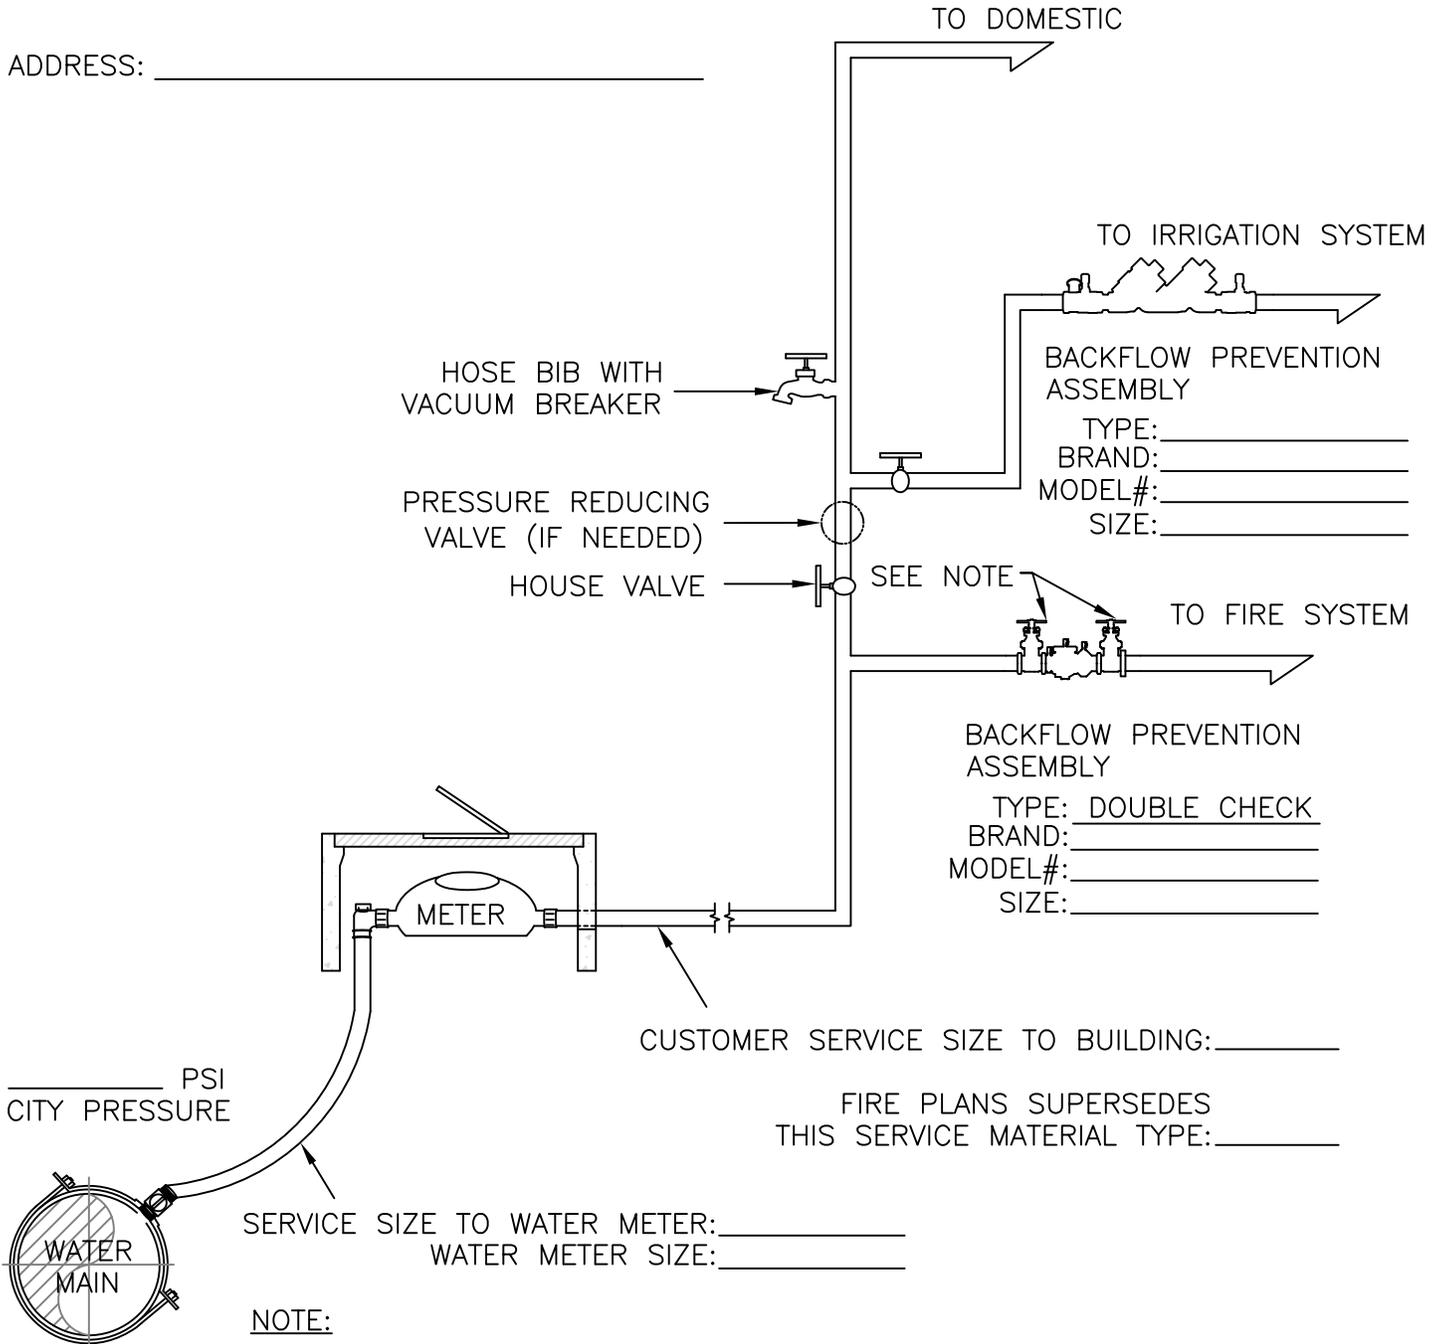

**NOTE:**

1. REMOVE DOUBLE CHECK VALVE HANDLES AND STORE IN SPARE HEAD BOX



**TYPICAL RESIDENTIAL WATER SERVICE DETAIL  
(WITH FIRE SYSTEM)**

DEPARTMENT OF PUBLIC WORKS

DATE: NOV 2012  
DRAWING NO.: W-1780

				DRAWN BY: L.T.	SCALE: NONE	SHEET 1 OF 1
				CHECKED BY: K.O.		
DATE	REVISION	BY	APPR.	APPROVED BY:		